

P. O, Box 418
Fernandina Beach,
Florida

October 18, 2001

Mr. J. M. Oxley, Jr., Clerk Of Courts
Nassau County Board of Commissioners
P. O. Box 4000
Fernandina Beach, Fl 32035

RE: Underground electric service to Courthouse building located at 416 Centre Street, Fernandina Beach Fl.

Dear Mr. Oxley:

In response to your request for underground electric service to the above referenced project, please be advised that electric service is available. Florida Public Utilities Company shall be obligated to furnish electric service to your location only as a result of, and under the terms of a properly executed agreement. Listed below are the characteristics, requirements and conditions of said agreement

Characteristics:

The service characteristics for this facility will be 4 wire, three phase, 120/208 volt service supplied from a pad-mounted transformer as shown on the enclosed sketch.

Requirements:

Florida Public Utilities Company shall perform the following:

1. Furnish and install primary cable as shown on the enclosed sketch.
2. Furnish and install watt hour and C. T. meters.
3. Furnish and install primary and secondary connectors used in the pad-mounted transformer.

The customer shall perform the following:

1. Furnish and install service cable. Cable sizes are limited to the following: 1/0, 2/0, 4/0, 350MCM, 500MCM and 750MCM. A maximum of six (6) conductors per phase will be allowed in each transformer.

2. Furnish and install primary and service conduits. All exposed conduits on the line side of the meters shall be rigid GALV steel or SCH 80 PVC.

3. Furnish and install concrete pad for transformer. Pad to be constructed to Florida Public Utilities Company's specifications. The transformer pad to be located as shown on the enclosed drawing. Approval of pad layout is required by Florida Public Utilities personnel prior to pouring concrete.

4. Furnish and install commercial metering centers.

5. Provide a minimum of 12 feet of unobstructed operating area on the front side of transformer and 2 feet of unobstructed operating area as measured from the edge of the pad on all other sides. Transformers shall be accessible for replacement by heavy motor vehicles.

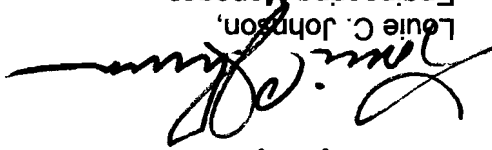
6. Conveyance of easements for Florida Public Utilities Company.

There will be no charge for underground electric service if the above requirements are met. Upon acceptance by you of this agreement, we shall schedule construction as soon as materials and labor can be made available.

Please find the following enclosed: 1) Drawing showing the approximate location of facilities to be extended.

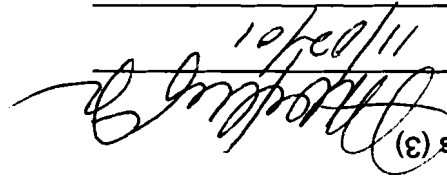
Should you have any questions, please do not hesitate to call.

Yours very truly,


Louis C. Johnson,
Engineering Manager

Enclosures (3)

Accepted:


11/20/01

Date: